


RESTRAINED DUCTILE IRON PIPE AND FITTINGS REQUIRED FROM BACKFLOW ASSEMBLY TO CITY MAIN. RESTRAIN EACH WAY AS DESIGNED AND REQUIRED BY AN ENGINEER LICENSED BY THE STATE OF TEXAS.

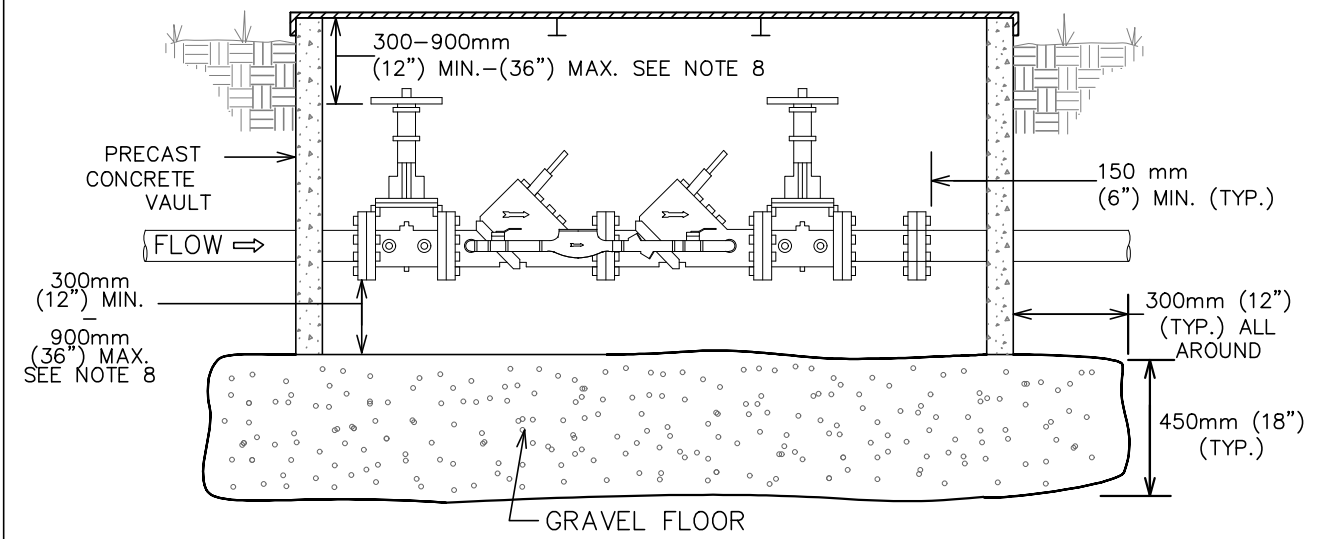

CITY OF CEDAR PARK ENGINEERING DEPARTMENT	STANDARD WATER LINE INSTALLATION WITHOUT MASTER METER	
	ADOPTED:	TBD
	SCALE:	NTS
	INITIAL:	TD

NOTES:

1. ALL BACKFLOW PREVENTION ASSEMBLIES SHALL HAVE LAB AND FIELD APPROVAL FROM THE UNIVERSITY OF SOUTHERN CALIFORNIA FOUNDATION FOR CROSS CONNECTION CONTROL AND HYDRAULIC RESEARCH.
2. ALL TEST PORTS SHALL BE DIRECTED UPWARD AND PLUGGED. TEST PORTS ARE LOCATED ON SERVICE SIDE. PLUGS SHALL BE NON-FERROUS.
3. BACKFLOW PREVENTION ASSEMBLIES SHALL BE INSTALLED IN THE UPRIGHT HORIZONTAL POSITION, UNLESS OTHERWISE APPROVED. BACKFLOW PREVENTION ASSEMBLIES SHALL NOT BE ROTATED ON THEIR AXIS.
4. CLEARANCE SHALL BE AS INDICATED, AND IN THE STANDARD CROSS CONNECTION ORDINANCES AND UCM.
5. ACCESS OPENING MUST BE LARGE ENOUGH TO REMOVE LARGEST PORTION OF BACKFLOW PREVENTER, BUT NOT LESS THAN 750 mm (30") IN LEAST DIMENSION.
6. TEST AND MAINTENANCE REPORT SHALL BE RECEIVED BY AUSTIN WATER UTILITY'S SPECIAL SERVICE DIVISION WITHIN 5 DAYS AFTER BEING INSTALLED.
7. VAULT SHALL NOT BE INSTALLED IN TRAFFIC AREA.
8. VAULT DEPTH MAY NOT EXCEED 1.8m (72"), BOTTOM OF LID TO TOP OF FLOOR.
9. HAND WHEELS SHALL BE HORIZONTALLY LOCATED WITHIN 300mm (12") OF ACCESS OPENING.
10. FOR ACCESS DOORS SEE SPL WW-614 OR APPROVED EQUAL (H2O LOADING REQUIRED).
11. FOR VAULT SEE SPL WW-298 OR APPROVED EQUAL (H2O LOADING REQUIRED).
12. VAULT PIPE WALL VOIDS SHALL BE SEALED WITH NON-SHRINK GROUT OR SEALANT PER SPL WW-146A OR APPROVED EQUAL.
13. THE TOP OF THE METER VAULT SHALL BE AT AN ELEVATION SUCH THAT THE SURROUNDING GROUND SLOPES AWAY FROM THE VAULT. ADDITIONAL DRAINAGE CONSIDERATION SUCH AS CONNECTION OF VAULT TO STORM SEWER, LATERAL DRAIN LINES FROM GRAVEL BED OR OTHER MEANS SHALL BE REQUIRED IF CONDITIONS CAUSE WATER TO COLLECT IN VAULT.
14. Detector water meter shall be a Sensus SR II 3/4" meter with AMI radio read capability. The City of Cedar Park will provide this meter.

CITY OF CEDAR PARK	STANDARD WATER LINE INSTALLATION WITHOUT MASTER METER
ENGINEERING DEPARTMENT	ADOPTED: TBD
	SCALE: NTS
	INITIAL: TD