


NOTE: NO METERS WILL BE SET IN BOXES PLACED IN SIDEWALKS OR PAVED AREAS OR BETWEEN SIDEWALK AND CURB

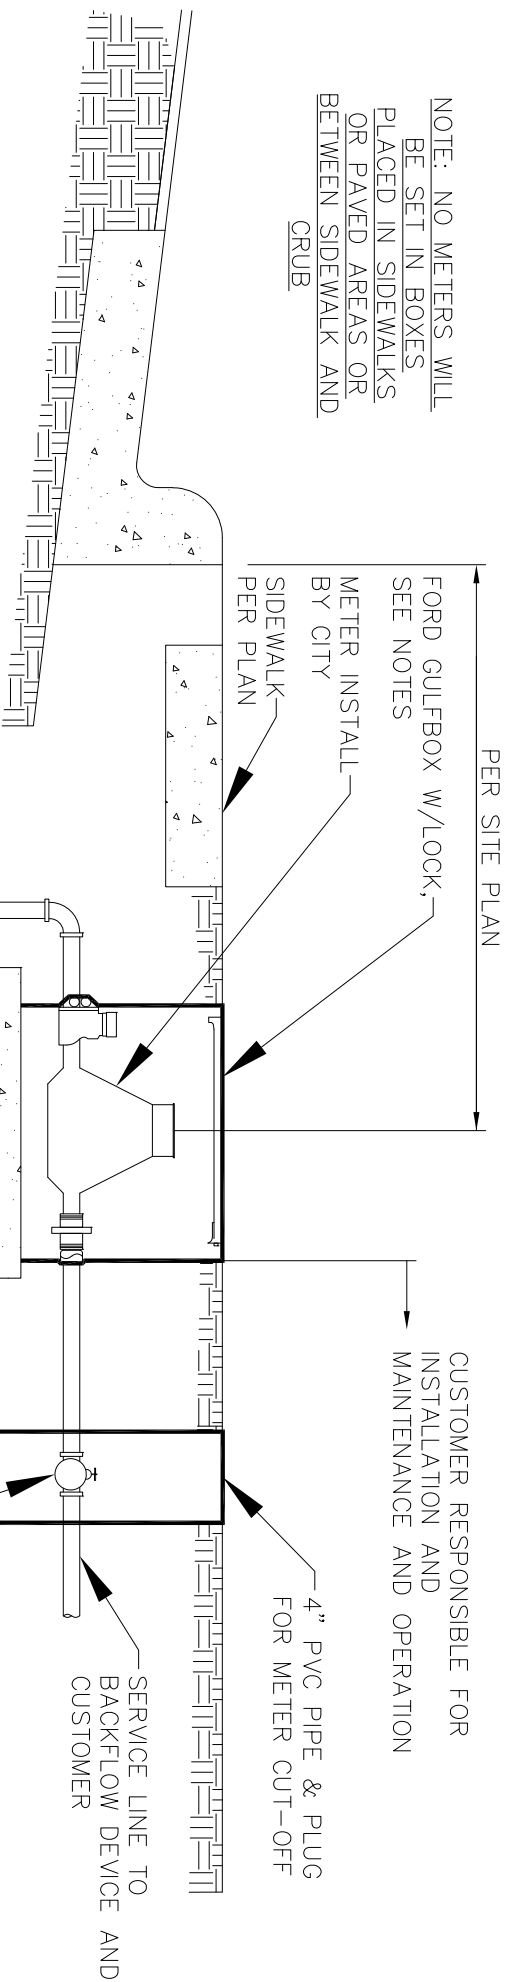

NOTES TO:
BUILDER, CONTRACTOR AND BUILDING INSPECTION:

A 4' RADIUS AROUND THE CENTER OF THE METER BOX MUST BE CLEAR OF PLANTS AND STRUCTURES, AND FINAL GRADING MUST BE < 2% (1" PER 1') WITHIN THE 4' RADIUS OR METER MAY NOT TRANSMIT CORRECTLY AND THE CUSTOMER'S ACCOUNT CAN NOT BE FINALIZED. THE OWNER AND CONTRACTOR RESPONSIBLE FOR THE PROPER USE OF THIS DETAIL. THE UTILITY MUST REJECT ANY INSTALL REQUEST WHERE COMMUNICATION CAN NOT BE ACHIEVED.

THIS DETAIL DOES NOT INCLUDE OR PRECLUDE ANY BACK-FLOW PREVENTION DEVICES, OR PRESSURE REDUCTION VALVES THAT MAY BE REQUIRED. CONSULT PERMIT AND BUILDING INSPECTION DEPARTMENT.

1 1/2" CORP. STOP (FORD OR APVD. EQUIV.) (2" CORP. STOP FOR 2" SERVICE)

IRRIGATION METERS SHALL NOT "LOOP" TO OTHER IRRIGATION METERS

CITY WILL DRILL A HOLE IN LID FOR ANTENNA.

NOTES FOR NON-RESIDENTIAL SERVICES ON EXISTING MAIN:

1. CITY OF CEDAR PARK WATER UTILITY WILL MAKE TAP ON EXISTING MAIN AND PROVIDE ALL PIPE AND APPURTENANCES LISTED IN PARTS LIST ITEMS #1.
2. A METER WILL NOT BE SET UNTIL ALL FINAL WORK IN THE RIGHT OF WAY IS COMPLETE, TESTED AND INSPECTED.

NOTES FOR NEW RESIDENTIAL SERVICES OR NON-RESIDENTIAL SERVICES ON NEW MAIN:

1. THE CONTRACTOR WILL PROVIDE ALL PARTS, FITTINGS, PIPE, BOXES AND APPURTENANCES SHOWN.
2. THE CONTRACTOR SHALL PERFORM ALL TAPS.
3. ALL TAPS SHALL BE COMPLETE, FLUSHED AND OPEN TO THE CURB STOP PRIOR TO MAIN TESTING.

CITY OF CEDAR PARK

DEPARTMENT OF PUBLIC WORKS

VER: 170724

STANDARD DETAIL FOR 1 1/2" OR 2" WATER METER SERVICE